


FIGURE 2-4: ENC28J60 ETHERNET TERMINATION AND EXTERNAL CONNECTIONS

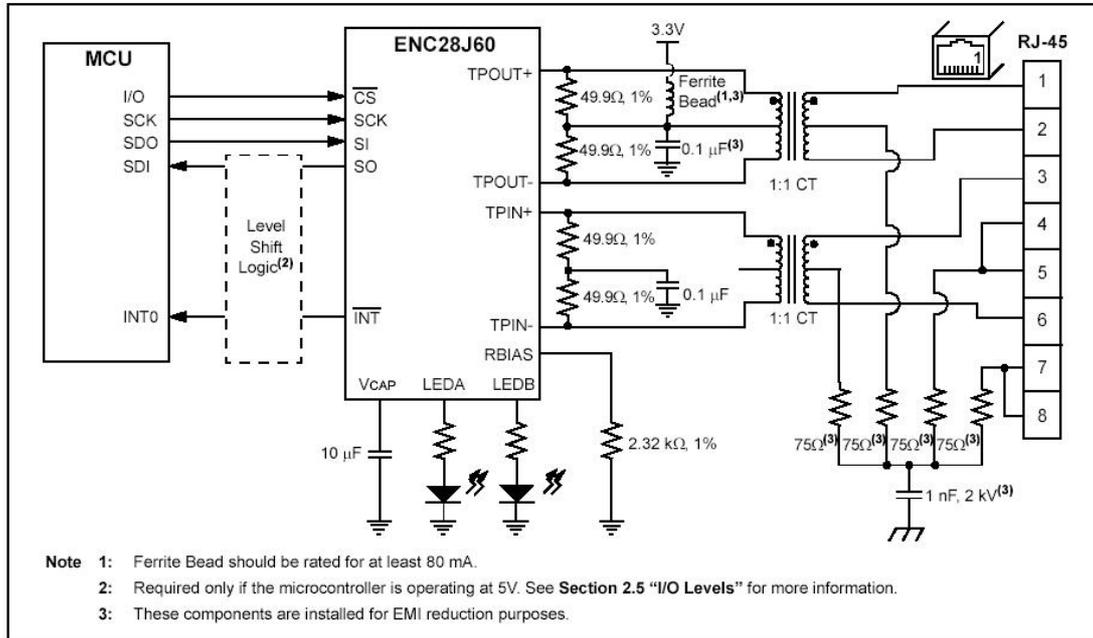

注：网络变压器可以用裕泰电子公司的 YL18-2050S, TX 1CT: 1CT  
RX 1CT: 1CT

OCL>350uH

或用 RJ45 带网络变压器 YL2J011A

联系方式: 0086-574-63620701,(0)13819804828

EMAIL: nico\_yu@yeah.net